NODAL DIAGRAM FOR ZONE IV-KERALASSERY GP-PROPOSED OHSR AT A.T.KUNNU

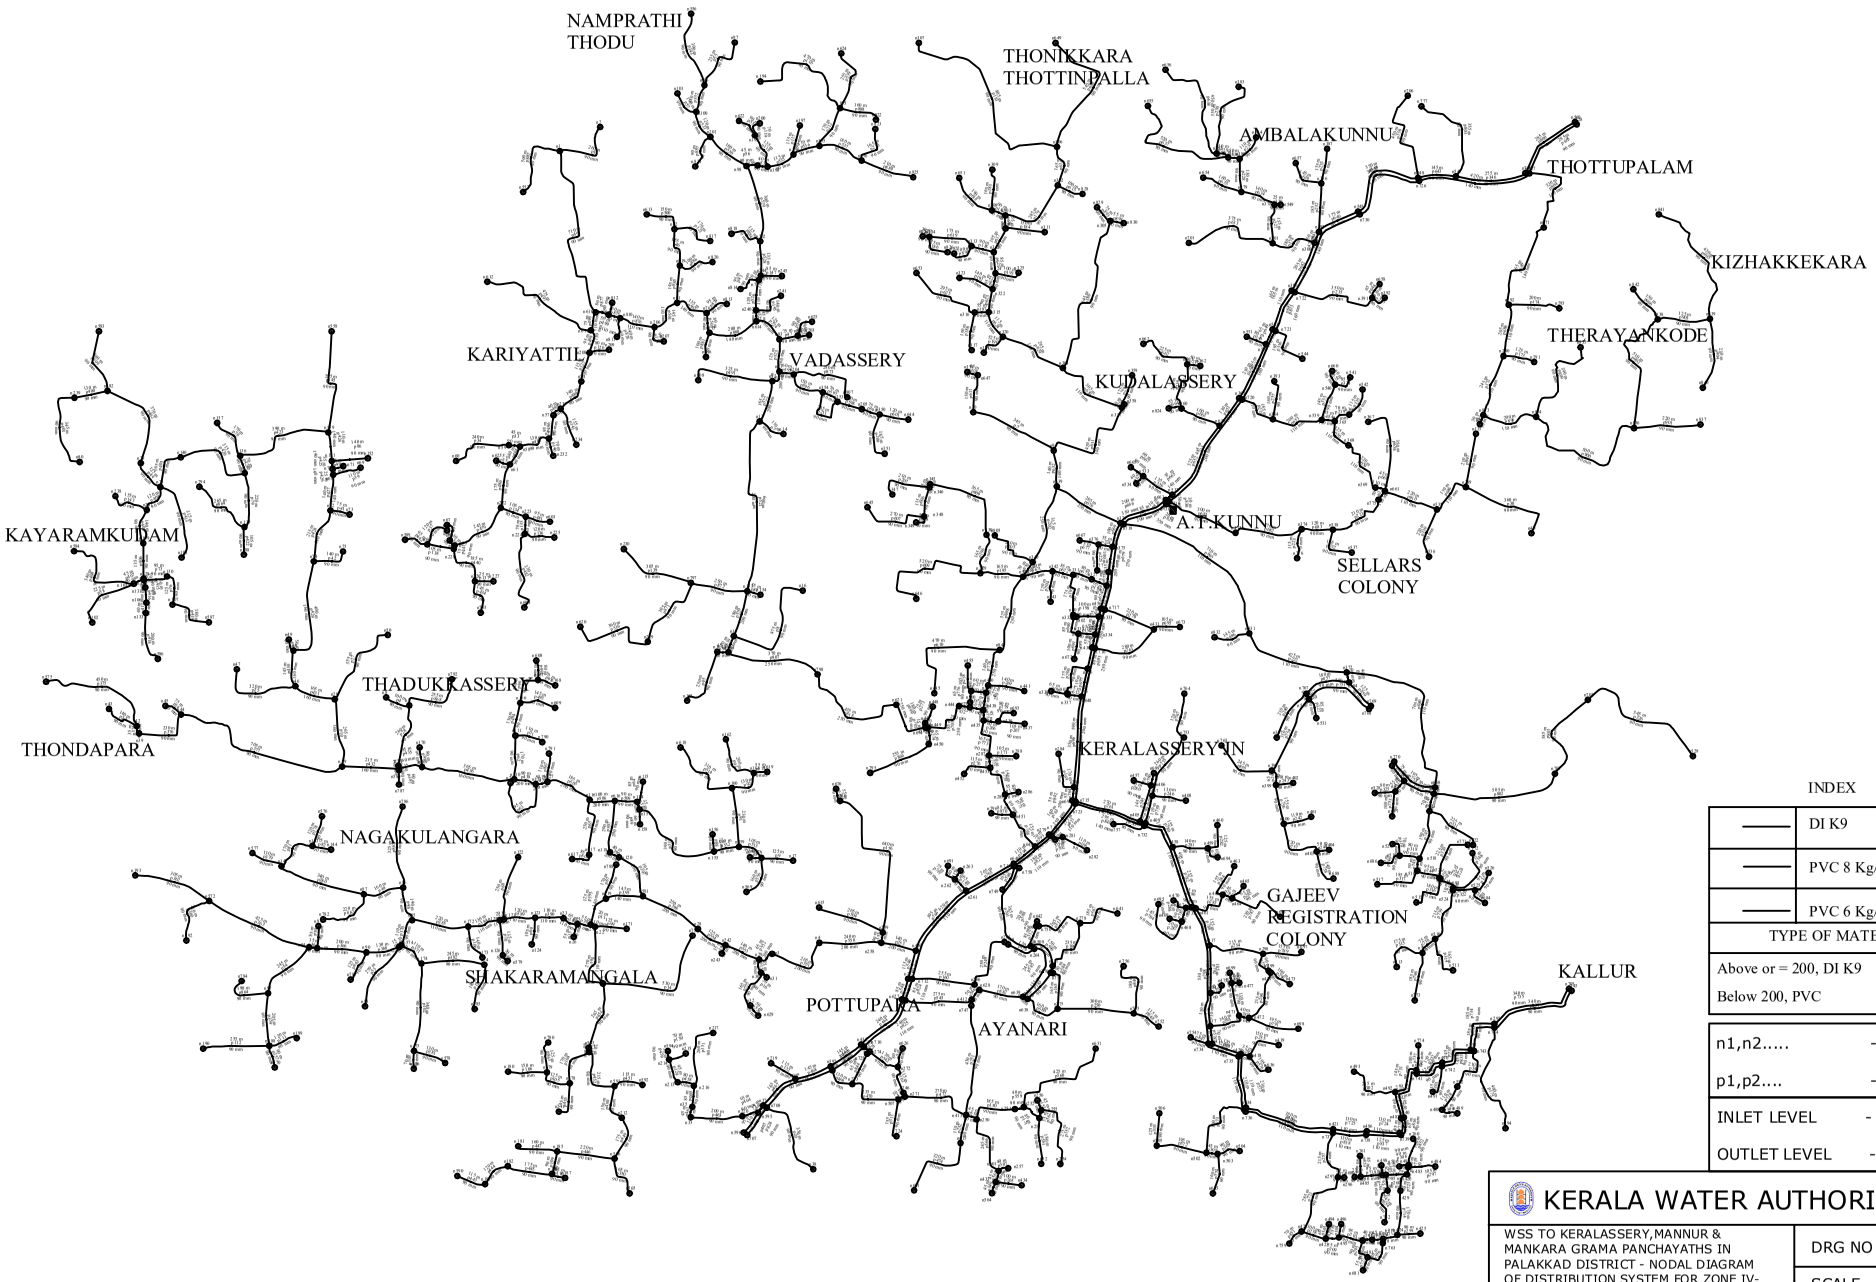

INDEX

———	DI K9
———	PVC 8 Kg/cm2
———	PVC 6 Kg/cm2

TYPE OF MATERIAL

Above or = 200, DI K9

Below 200, PVC

n1,n2.....	- Nodes
p1,p2....	- Pipes
INLET LEVEL	- +127.135m
OUTLET LEVEL	- +123.135m

KERALA WATER AUTHORITY

WSS TO KERALASSERY,MANNUR & MANKARA GRAMA PANCHAYATHS IN PALAKKAD DISTRICT - NODAL DIAGRAM OF DISTRIBUTION SYSTEM FOR ZONE IV-KERALASSERY GP, PROPOSED OHSR AT A.T.KUNNU

DRG NO - 2 /2

SCALE

DATE -

AE	AEE	EE	SE	CE